

Installation

Purpose of this Document

This document provides instructions to install warning labels for static electric fire hazard. The installation instructions for typical Gilbarco® dispensers are included.

Static electric flash fires have occurred in some instances when fuel is dispensed into portable containers in or on motor vehicles rather than on the ground. In most cases these containers were left on the plastic bedliner of a pickup truck. The resulting accidents have caused property damage and serious bodily injury.

The warning labels included in the attached kit provide graphics and text to warn the public about unsafe practices when fuel is dispensed into portable containers, and to inform the public of the NFPA¹ and NHTSA² approved procedures for filling portable containers.


Parts List

Part Description	Part Number (Current)	Kit Number (Current)	Part Number (Previous)	Kit Number (Previous)	Quantity
Warning Labels - International (includes Canadian Provinces - except Quebec)	R60032-06	(Kit Q13763-04)	R60032-01	(Kit Q13763-01)	2
Warning Labels - Domestic	R60032-08	(Kit Q13763-05)	R60032-03	(Kit Q13763-02)	2
Warning Labels - Quebec	R60032-07	(Kit Q13763-06)	R60032-04	(Kit Q13763-03)	2

Installing Warning Labels

- 1 Clean the surface area of the installation location using a cloth moistened with isopropyl alcohol. Let the area dry before installing warning label.
- 2 Install one warning label on each side of the dispenser. Install each warning label on the dispenser **where it will be clearly visible to anyone dispensing fuel.**

Refer to the following illustrations for the recommended location of warning label on your model dispenser.

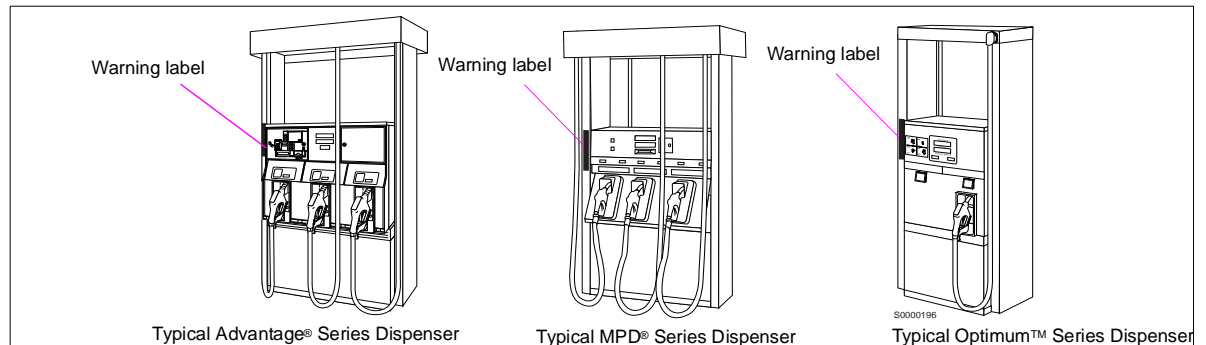

1.NFPA: National Fire Protection Association
 2.NHTSA: National Highway Traffic Safety Administration

*Note: These illustrations show typical Gilbarco dispensers
- not all dispenser models are shown.*

