




Instructions for Retrieving Data for TLS-350 to TLS-450PLUS ATG Upgrade





Easily retrieve console configurations to upgrade to the TLS-450PLUS Automatic Tank Gauge (ATG) by following all five steps sequentially.

Screens referenced below may vary slightly depending on your ATG.


1 System Information (Software & Features)

- Start at the **main screen**:

- Press **MODE** twice:

- Press **FUNCTION** once:

- Press **PRINT**


2 System Configuration (Modules)

- Press **STEP** four times until you are at the **System Configuration screen**:

- Press **PRINT**
- Press **STEP** four times until you are at the **DIM Diagnostic Data screen**:

- Press **PRINT**

3 In-Tank Diagnostic (Probes)

- From the DIM Diagnostic Data screen, press **FUNCTION** twice until you are at the **In-Tank Diagnostic screen**:

- Press **PRINT**

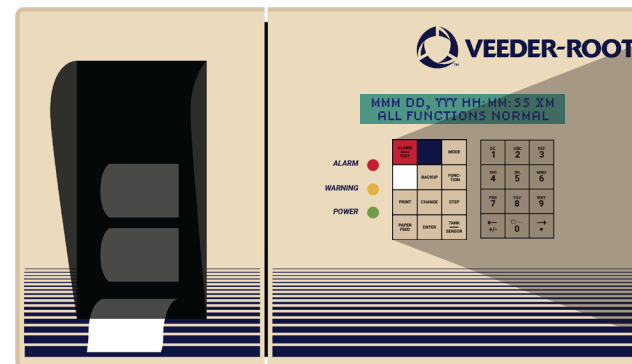
4 General Setup (Sensors, Line Leak, and DIMs)

- Press **MODE** once until you see the **Setup Mode screen**:

- Press **PRINT**

5 Final Steps

- Collect your printouts and send them to your distributor to build your **TLS-450PLUS Bill of Materials**.

YOUR TLS-350



KEYPAD

ALARM TEST		MODE
	BACKUP	FUNCTION
PRINT	CHANGE	STEP
PAPER FEED	ENTER	TANK SENSOR